

F

E

D

C

B

A

F

E

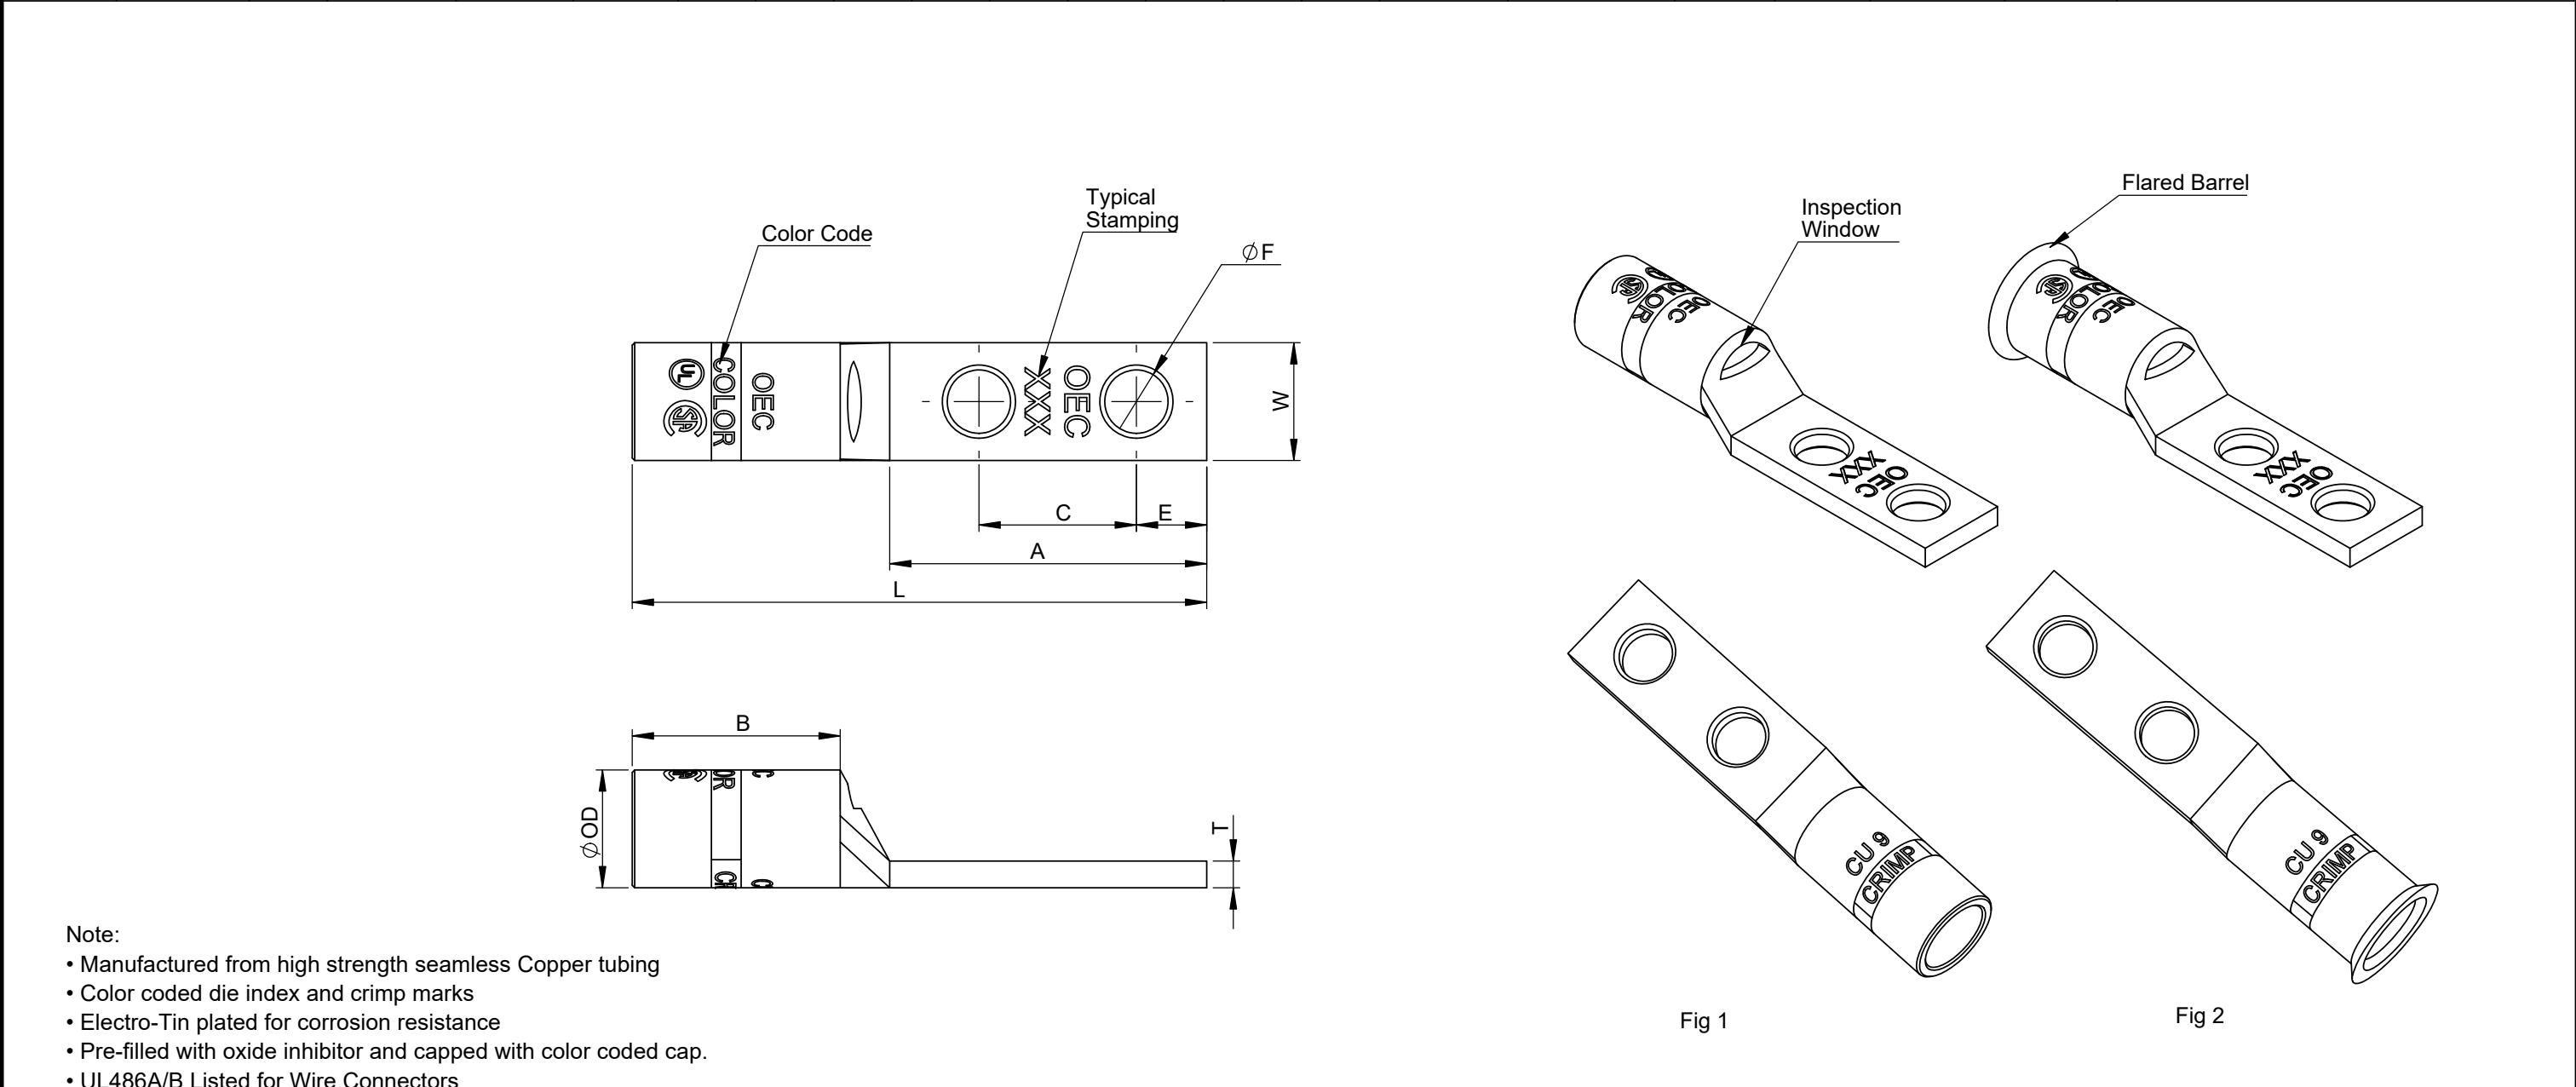
D

C

B

A

Catalog Id		Conductor			Stud Size	Dimensions									Color Code	Installation Tooling				Dieless	
Without Flared Barrel (Fig-1)	With Flared Barrel (Fig-2)	AWG	Flex Conductor G,H,I,K,M & DLO	Expanded Cod. Range		OD	L	B	A	W	T	ØF	E	C		Burndy Model - Y35, Y39, Y750, PAT750, PAT750LI	Ilsco ILC-12-N, ILC-12-H-N, ILCB-12	Huskie Model - EP-510C Die Index	Greeniee HK1240		
98046NT	F98046NT	#4	#5	#4 - #6	1/4	0.34 [8.70]	2.09 [53.00]	0.71 [18.00]	1.26 [32.00]	0.34 [8.70]	0.09 [2.20]	0.25 [6.40]	0.28 [7.10]	0.62 [15.90]	Gray	U4CRT U6CABT	ILD - 4	ILD - 29	HT41AU / HT41GE	KC12-4	Burndy Dieless - PAT444S & PAT4PC834LI.
98046ANT	F98046ANT				1/4	0.34 [8.70]	2.68 [68.00]	0.75 [19.00]	1.81 [46.00]	0.34 [8.70]	0.09 [2.20]	0.25 [6.40]	0.28 [7.10]	1.00 [25.40]							Ilsco Dieless - IDT-6, IDT-6H, IDTB-6, IDTB-6-LIO, TB-6DF1000-P, IDT-12-N, IVTB-6.
Greenlee & NSI Dieless - HK12ID, EK12IDL, N12ID.																					





- Note:
- Manufactured from high strength seamless Copper tubing
  - Color coded die index and crimp marks
  - Electro-Tin plated for corrosion resistance
  - Pre-filled with oxide inhibitor and capped with color coded cap.
  - UL486A/B Listed for Wire Connectors
  - UL Listed and CSA Certified with competitor's compression tools
  - Listed for use with class B & C, flex class G, H, I, K, M & DLO cable

Crimping Instructions

- Select the proper lug or splice connector for the size of cable being installed, ensuring that the size matches the description in the table.
- Strip the insulation from the cable to a length so that the stripped area of the cable can be completely inserted into and fill the barrel of the lug or splice. Carefully strip the insulation from the cable without nicking the strands.
- Clean the stripped portion of the cable to remove oxide films.
- The stripped portion of the cable must be clean and inserted completely into the connector barrel.
- Using the tool and die combination specified for that connector in the table above, install crimps, leaving a space of 1/8 inch minimum between successive crimps.  
For Short Barrel Connectors, apply 1 crimp,  
For Long Barrel Connectors, apply 2 crimps on the color coded bands

THE INFORMATION CONTAINED WITHIN THIS DOCUMENT IS PROPRIETARY TO OEC AND MAY NOT BE DISCLOSED WITHOUT PRIOR WRITTEN CONSENT

					TOLERANCE					
					OD	L	B	A	W	ØF
					±0.20	±1.0	±0.50	±0.50	±1.0	±0.20
TOLERANCES-UNLESS OTHERWISE SPECIFIED  2 PL. DEC. ±.015    TRUE C.L. ±.015 3 PL. DEC. ±.015    ANGLES ±.015			NAME	DATE	<div> <b>Usa Inc.</b></div> 106 Northfield Avenue, Edison, NJ 08837, Phone: +1 732-479-0469    www.oec-americas.com					
			DRAWN	R.P.			28.02.25			
			CHECK	S.P.			28.02.25			
			APPROVED	M.K.			28.02.25			
DWG. NO. <b>OC-0005</b>		PROJECTION:  FIRST ANGLE		SIZE A3	TITLE: Copper Two Hole Standard Barrel Compression Lug Narrow Tang					
MATERIAL    Refer Note										
FINISH        Refer Note										
Cat Id. 98046NT - 98046ANT					REV					
DO NOT SCALE DRAWING					SHEET 1 OF 17					

THE INFORMATION CONTAINED WITHIN THIS DOCUMENT IS PROPRIETARY TO OEC AND MAY NOT BE DISCLOSED WITHOUT PRIOR WRITTEN CONSENT