

F

E

D

C

B

A

Catalog Id		Conductor			Stud Size	Dimensions						Color Code	Installation Tooling				Dieless	
Without Inspection Window (Fig-1)	With Inspection Window (Fig-2)	AWG	Flex Conductor G,H,I,K,M & DLO	Expanded Cod. Range		OD	L	B	A	W	T		Burndy Model - Y35, Y39, Y750, PAT750, PAT750LI	IlSCO ILC-12-N, ILC-12-H-N, ILCB-12		Huskie Model - EP-510C Die Index		Greenlee HK1240
BT98085	PBT98085	#6	#7	#6 - #8	1/4	0.29 [7.50]	2.36 [60.00]	0.98 [25.00]	1.26 [32.00]	0.42 [10.70]	0.08 [2.10]	Blue	U5CRT U8CABT	ILD - 3	ILD - 24	HT41AT / HT41GL	KC12-6	Burndy Dieless - PAT444S & PAT4PC834LI. IlSCO Dieless - IDT-6, IDT-6H, IDTB-6, IDTB-6-LIO, TB-6DF1000-P, IDT-12-N, IVTB-6. Greenlee & NSI Dieless - HK12ID, EK12IDL, N12ID.
BT98085A	PBT98085A				1/4	0.29 [7.50]	2.24 [57.00]	0.98 [25.00]	1.14 [29.00]	0.42 [10.70]	0.08 [2.10]							
BT98085B	PBT98085B				1/2	0.29 [7.50]	4.09 [104.00]	0.98 [25.00]	2.99 [76.00]	0.83 [21.00]	0.08 [2.10]							
BT98085C	PBT98085C				1/4	0.29 [7.50]	2.48 [63.00]	0.98 [25.00]	1.37 [35.00]	0.42 [10.70]	0.08 [2.10]							
BT98085D	PBT98085D				3/8	0.29 [7.50]	2.91 [74.00]	0.98 [25.00]	1.81 [46.00]	0.55 [14.00]	0.06 [1.60]							
BT98085E	PBT98085E				3/8	0.29 [7.50]	2.72 [69.00]	0.98 [25.00]	1.61 [41.00]	0.55 [14.00]	0.06 [1.60]							

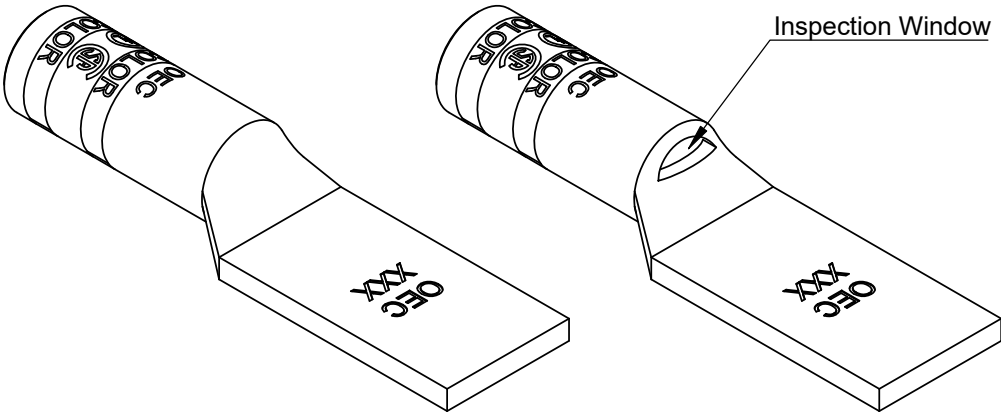
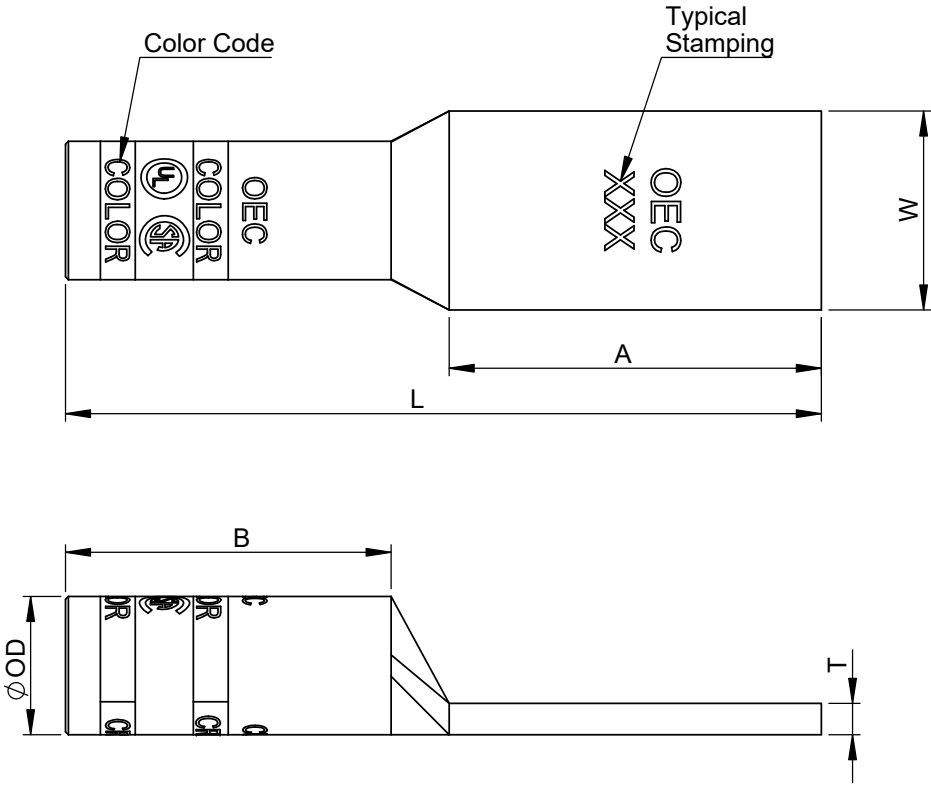


Fig-1

Fig-2



- Note:
- Manufactured from high strength seamless Copper tubing
 - Color coded die index and crimp marks
 - Electro-Tin plated for corrosion resistance
 - Pre-filled with oxide inhibitor and capped with color coded cap.
 - UL486A/B Listed for Wire Connectors
 - UL Listed and CSA Certified with competitor's compression tools
 - Listed for use with class B & C, flex class G, H, I, K, M & DLO cable

Crimping Instructions

- Select the proper lug or splice connector for the size of cable being installed, ensuring that the size matches the description in the table.
- Strip the insulation from the cable to a length so that the stripped area of the cable can be completely inserted into and fill the barrel of the lug or splice. Carefully strip the insulation from the cable without nicking the strands.
- Clean the stripped portion of the cable to remove oxide films.
- The stripped portion of the cable must be clean and inserted completely into the connector barrel.
- Using the tool and die combination specified for that connector in the table above, install crimps, leaving a space of 1/8 inch minimum between successive crimps.
For Short Barrel Connectors, apply 1 crimp,
For Long Barrel Connectors, apply 2 crimps on the color coded bands

THE INFORMATION CONTAINED WITHIN THIS DOCUMENT IS PROPRIETARY TO OEC AND MAY NOT BE DISCLOSED WITHOUT PRIOR WRITTEN CONSENT

TOLERANCE				
OD	L	B	A	W
±0.20	±1.0	±0.50	±0.50	±1.0

TOLERANCES-UNLESS OTHERWISE SPECIFIED 2 PL. DEC. ±.015 TRUE C.L. ±.015 3 PL. DEC. ±.015 ANGLES ±.015		NAME	DATE	 Usa Inc. 106 Northfield Avenue, Edison, NJ 08837, Phone: +1 732-479-0469 www.oec-americas.com
	DRAWN	R.P.	08.03.25	
	CHECK	S.P.	08.03.25	
	APPROVED	M.K.	08.03.25	
DWG. NO. OC-0014	PROJECTION: 	FIRST ANGLE	SIZE A3	TITLE: Copper Two Hole Long Barrel Compression Lug Blank Tang
MATERIAL	Refer Note			
FINISH	Refer Note			
				Cat Id. BT98085 - BT98085E REV
				DO NOT SCALE DRAWING SHEET 2 OF 19

F

E

D

C

B

A